



# TEST REPORT



KERI



**한국전기연구원**  
**KOREA ELECTROTECHNOLOGY**  
**RESEARCH INSTITUTE**



# TEST REPORT

2016DS00025 1/8

CLASSIFICATION Performance Test

TEST OBJECT Industrial terminal block

DESIGNATION -  
4P AC 600 V 30 A

RECEIPT No. RRD16S00012 (2016-01-14)

APPLICANT SAMIL ENTERPRISE CO., LTD.  
994-10, Pocheon-ro, Gunnae-myeon, Pocheon-si, Gyeonggi-do, Korea

MANUFACTURER SAMIL ENTERPRISE CO., LTD.  
994-10, Pocheon-ro, Gunnae-myeon, Pocheon-si, Gyeonggi-do, Korea

DATE OF TESTS 2014-07-01 ~ 2014-07-11

DATE OF ISSUE 2016-03-04

This report is the republication of test report No. 2014TS01901(2014-07-18) translated from Korean into English.

The tests have been carried out in accordance with the applicant's instructions.

This Test Report has been issued by KERI.

The test results are shown in the records of tests with the performance of the test object and the observations made during the tests. The oscillograms are attached hereto.

Only integral reproduction of this Report is permitted without written permission from KERI. Electronic copies in PDF-format or scanned version of this Report may be available and have the status "for information only". The sealed and bounded version of the Report is the only valid version.

This report shall not be used for any purpose such as exaggerated advertisement, misuse, and/or legal proceedings, except for information only.

TOTAL No. OF PAGES(8) : records (6), photographs (1), circuit diagrams (0),  
drawings & descriptions (0), attachments(0), oscillograms (1)



Prepared by

Shon , Wha-Young

Verified by  
(Technical manager)

Jeong , Jung-Il

Approved by

Lee Yong Jun

Power Apparatus Testing & Evaluation Division



KOREA ELECTROTECHNOLOGY RESEARCH INSTITUTE(ANSAN)  
111, Hangeul-ro, Sangnok-gu, Ansan-si, Gyeonggi-do, 15588, Republic of Korea  
Tel : +(0)82-(0)31-8040-4114, Fax : +(0)82-(0)31-8040-4499, [www.keri.re.kr](http://www.keri.re.kr)



**Table of contents**

Items	Sheet No.
Table of contents	2/8
Ratings	3/8
List of tests	4/8
Test results	5/8 ~ 6/8
Photographs	7/8
Circuit diagrams and parameters	-
Drawings	-
Attachments	-
Oscillograms	8/8

**Tested by :**

Shon, Hwa-Young

KERI

**Witnessed by : N.A****Drawings : N.A**

**Industrial terminal block**

Applied standard

Manufacturer

Designation

Serial Number

Date of manufacture

Applicant's specification

SAMIL ENTERPRISE CO., LTD.

-

-

-

Ratings of the test object assigned by manufacturer and proved by tests : N.A.

Ratings of the test object assigned by manufacturer :

Number of poles

4 P

Rated voltage

AC 600 V

Rated current

30 A

Power-frequency withstand voltage

2.5 kV 60 s



## List of the tests :

Test items	Standard and clause	Test date	Sheet No.
1 Insulation resistance measurement	Applicant's specifications	2014-07-01	5/8
2 Power-frequency voltage withstand test	Applicant's specifications	2014-07-01	5/8
3 Temperature-rise test	Applicant's specifications	2014-07-03	5/8
4 Tensile test	Applicant's specifications	2014-07-11	6/8
5 Description of tests	-	-	6/8



KERI

복사본





## 1 Insulation resistance measurement

Test method(s) and requirement(s)		Test result(s)
Condition : Install the terminal block on a metal plate. Test requirement(s) : Not less than 20 MΩ Measuring devices : DC 500 V megger	Between the adjacent terminal blocks	Not less than 2 000 MΩ
	Between all terminal blocks connected together and the support to which the terminal blocks are attached	Not less than 2 000 MΩ
* Atmospheric conditions : 23.3 °C, 62.1 % R.H., 1 007 hPa		

## 2 Power-frequency voltage withstand test

Test method(s) and requirement(s)		Test result(s)
Test method(s) - Test voltage and time : AC 60 Hz, 2.5 kV, 1 min Test requirement(s) - During the test, no flashover, breakdown of insulation or any other manifestation of disruptive discharge shall occur	Between the adjacent terminal blocks	Withstood
	Between all terminal blocks connected together and the support to which the terminal blocks are attached	Withstood
* Atmospheric conditions : 23.3 °C, 62.1 % R.H., 1 007 hPa		

## 3 Temperature-rise test

Test method(s) and requirement(s)					
The temperature rise shall not exceed the limits.					
1) Test frequency: 60 Hz					
2) Test current: 30 A					
3) Connection conductor: Vinyl-insulated wire 4.0 mm²					

Channel No.	Measuring point	Measurement method	Limit of temperature rise	Measured values		Test result(s)
1	Terminal (2P of incoming part)	Thermocouples	45 K	66.0 °C		40.6 K
2	Terminal (2P of output part )			64.5 °C		39. K
3	Ambient temperature		-	25.5 °C	Average : 25.4 °C	-
4	Ambient temperature		-	25.3 °C		

\* Refer to Osc. SG01: Recording paper of temperature-rise



#### 4 Tensile test

Test method(s) and requirement(s)	Test result
<p>Tested in the condition below, when tensile force is applied then there should not be any deformation, break and failure.</p> <ul style="list-style-type: none"><li>- Joint cable : 4.0 mm<sup>2</sup></li><li>- Tightening torque of terminal nut : 1.2 N·m</li><li>- Tensile force : 100 N</li><li>- Application time : 1 min</li></ul>	Good


#### 5 Description of test

- 5.1 The above test are carried out on the test objects submitted and confirmed by the applicant in accordance with applicant's instructions. The end.





## Photographs

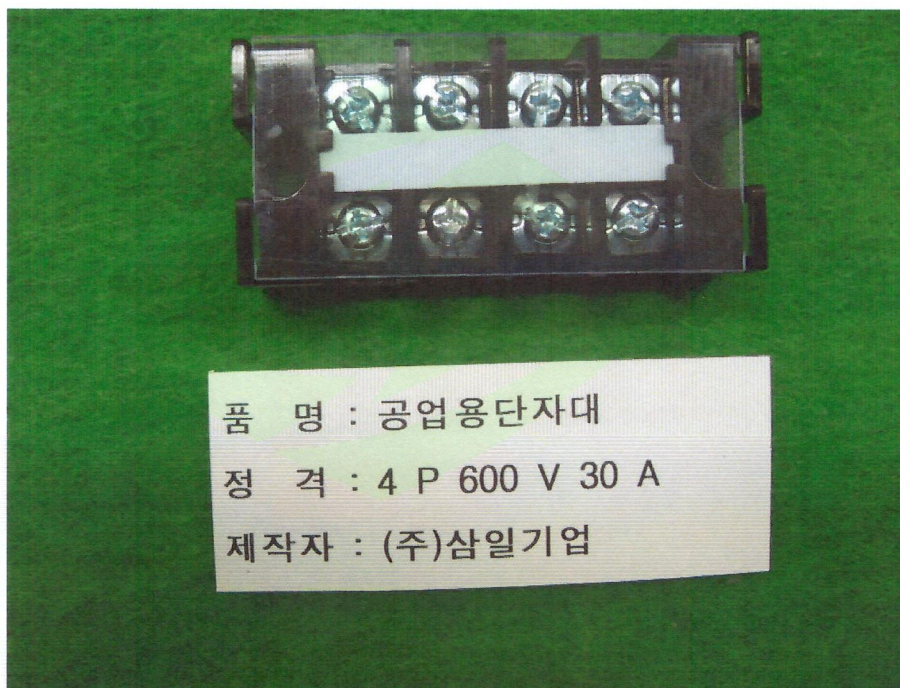

Test object : Industrial terminal block

Designation : -

Ratings : 4P 600 V 30 A

Manufacturer : SAMIL ENTERPRISE CO., LTD.

Photo. SG01 : Test object





## Oscillogram

